

68925/5




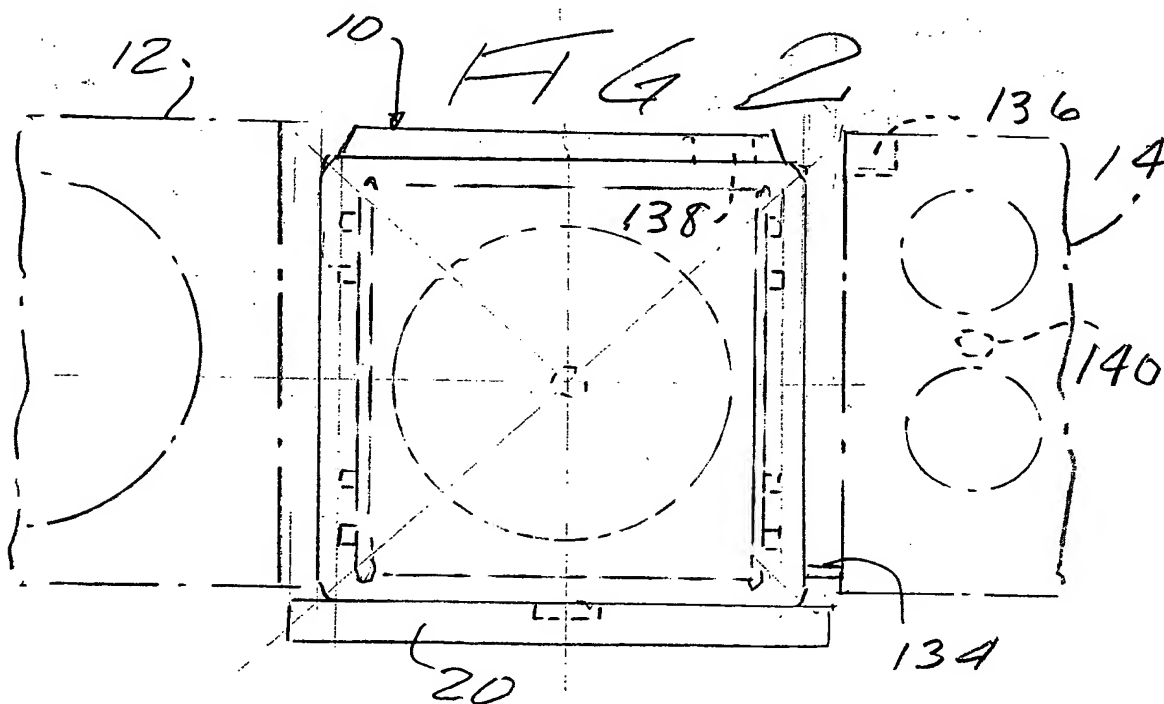


FIG 3

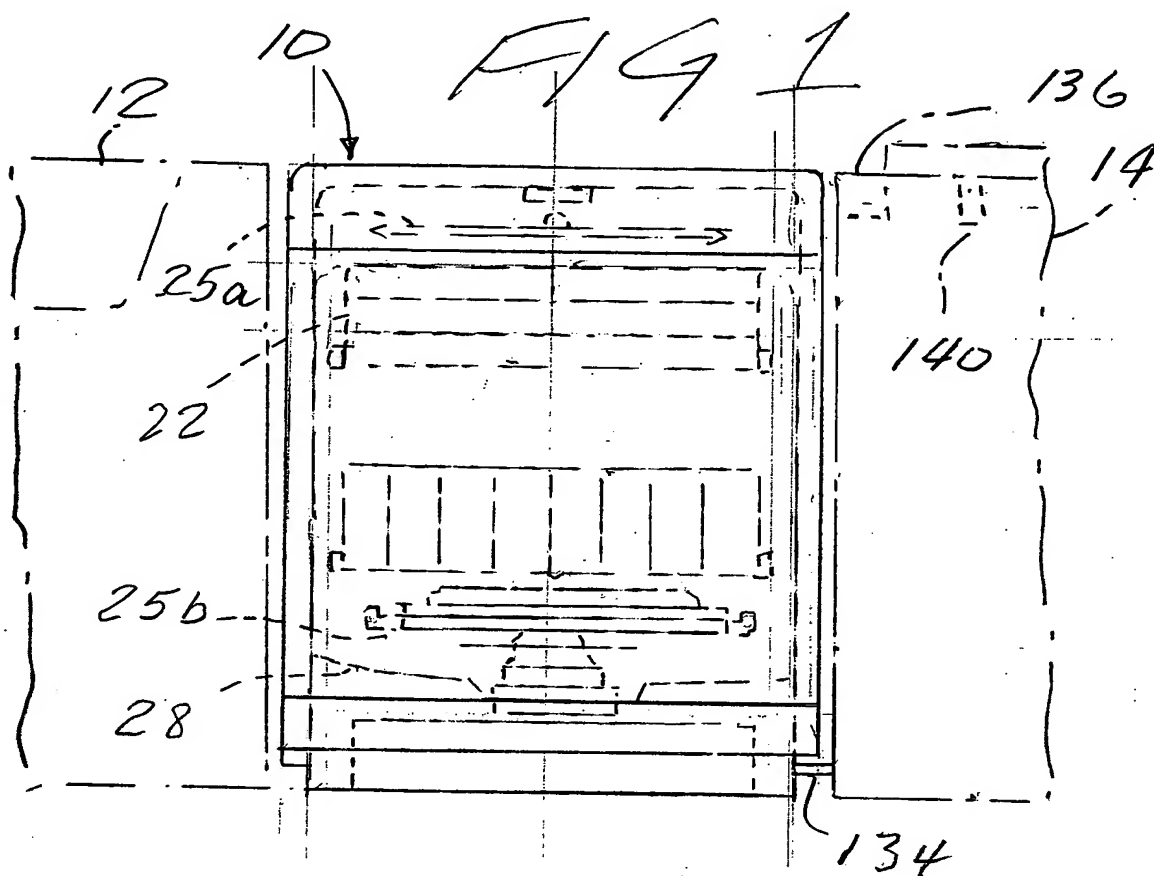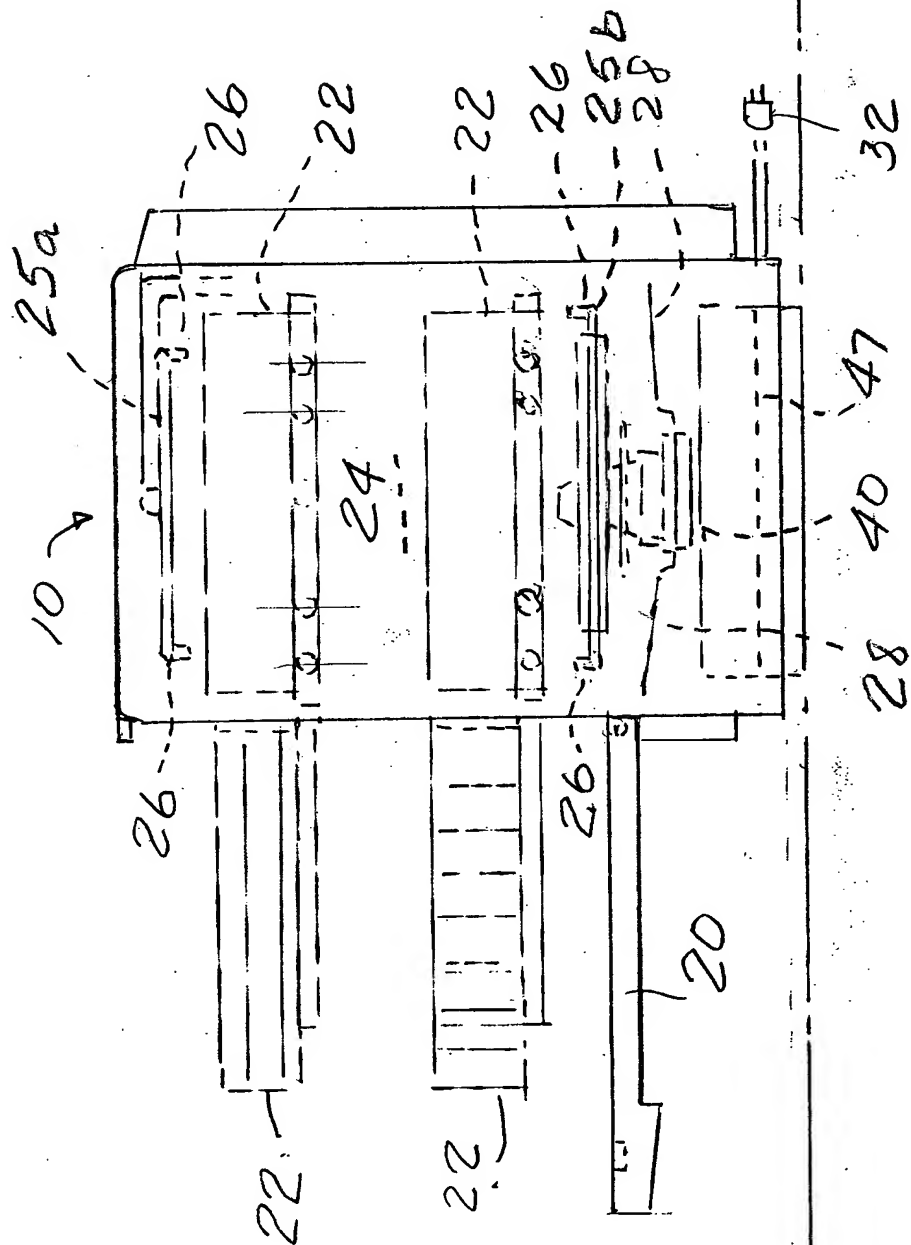

68925/5

FIG 4

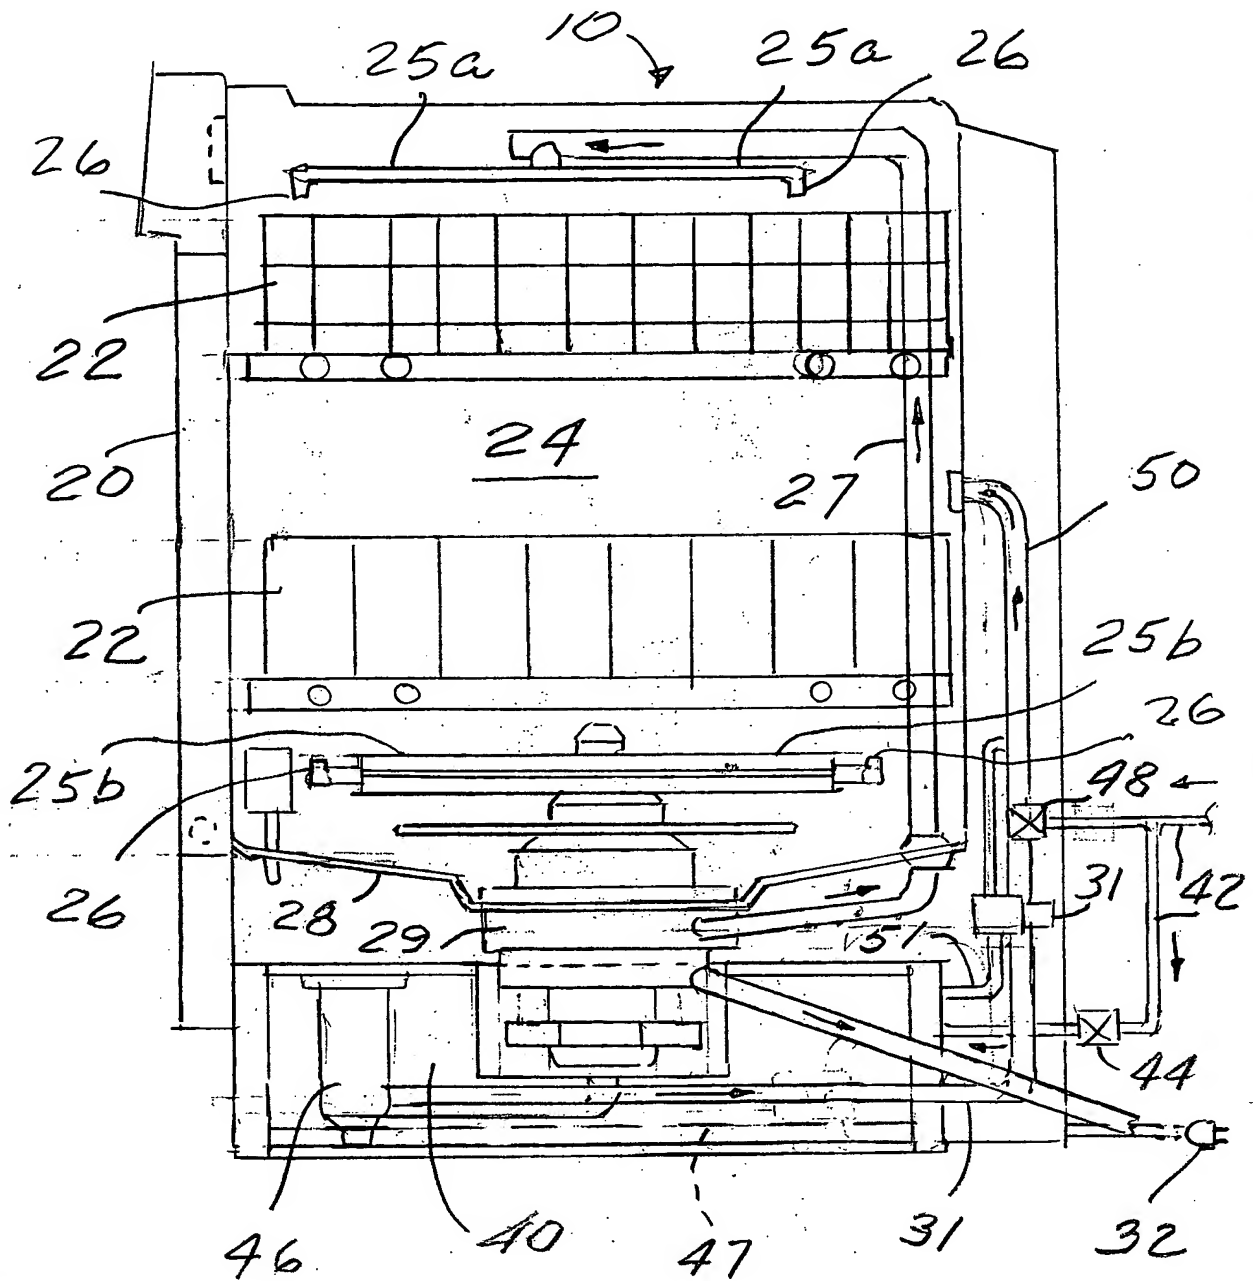

BEST AVAILABLE COPY

FIG. 5


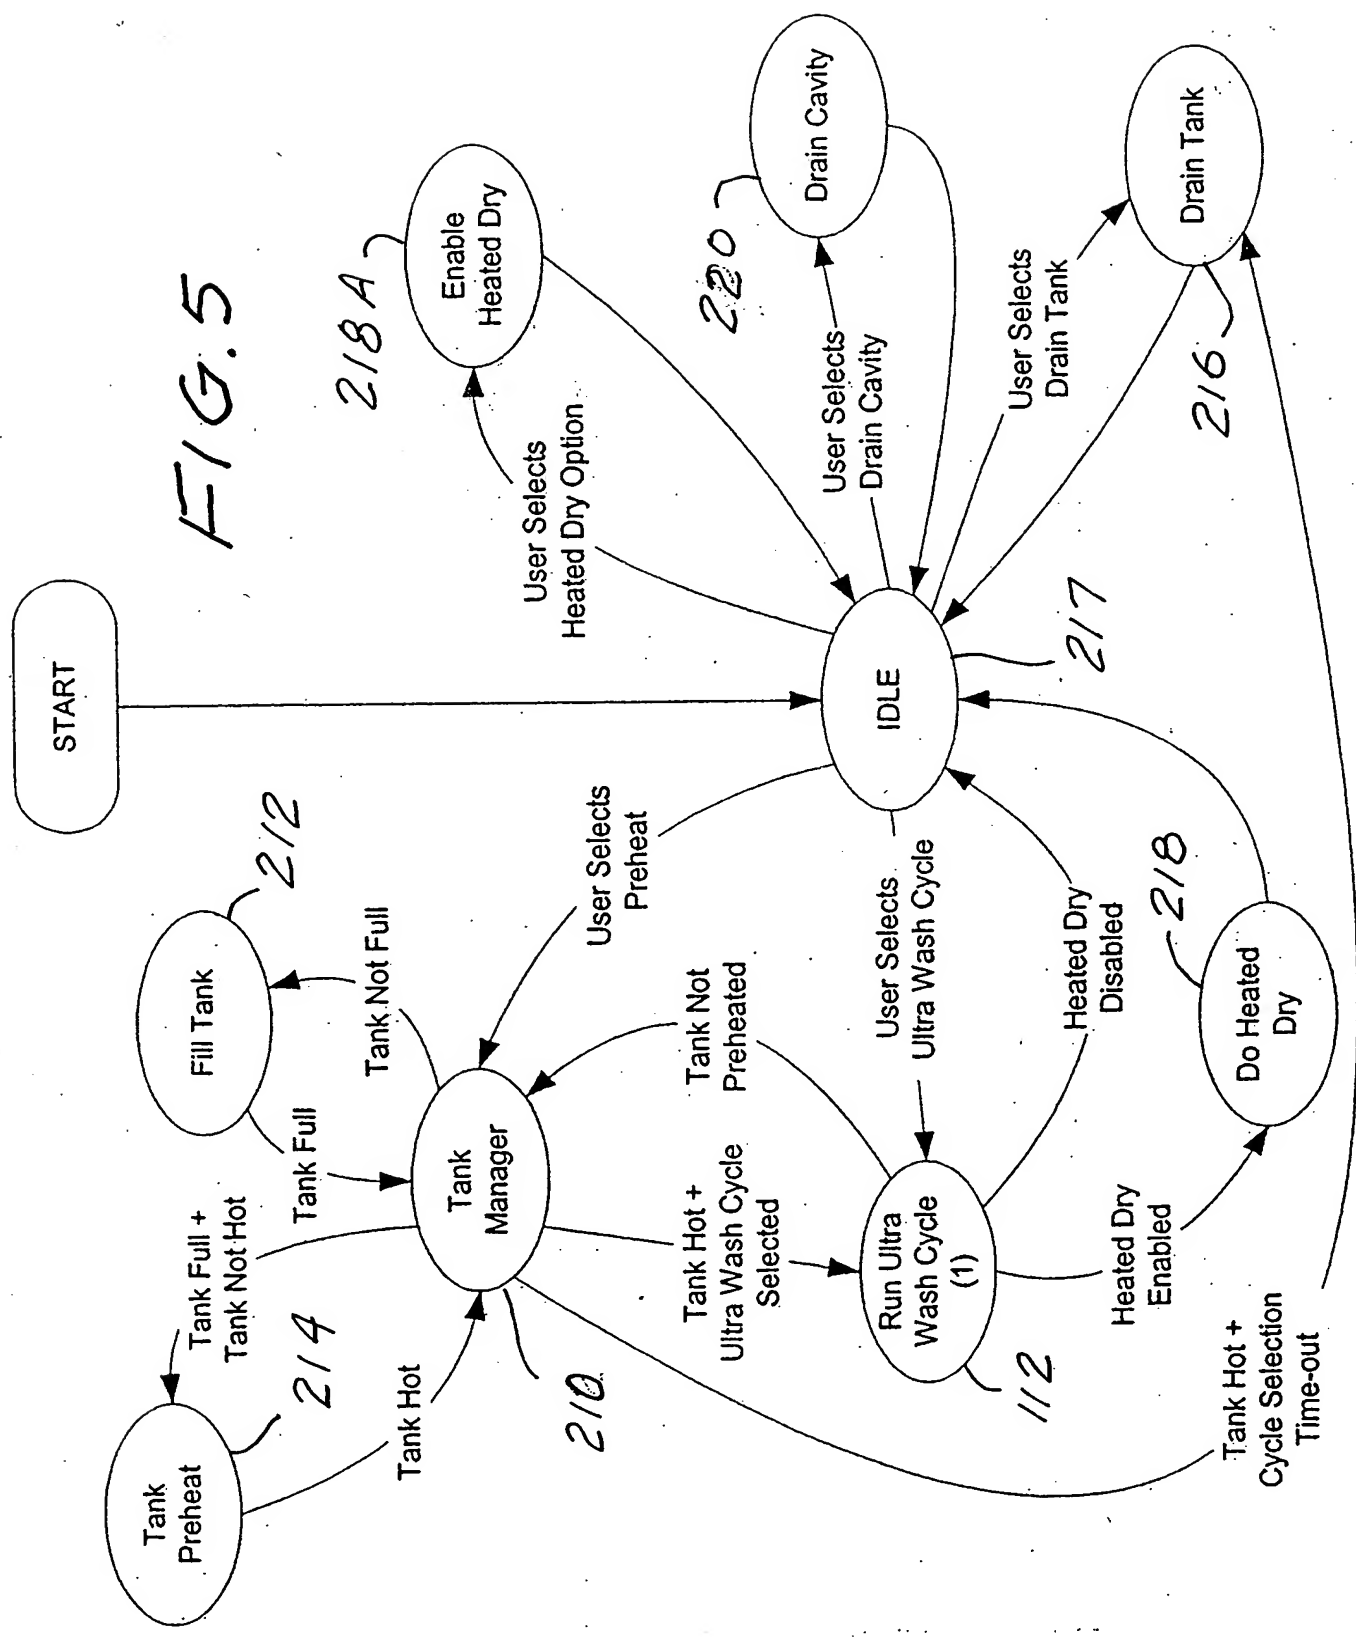


FIG. 6

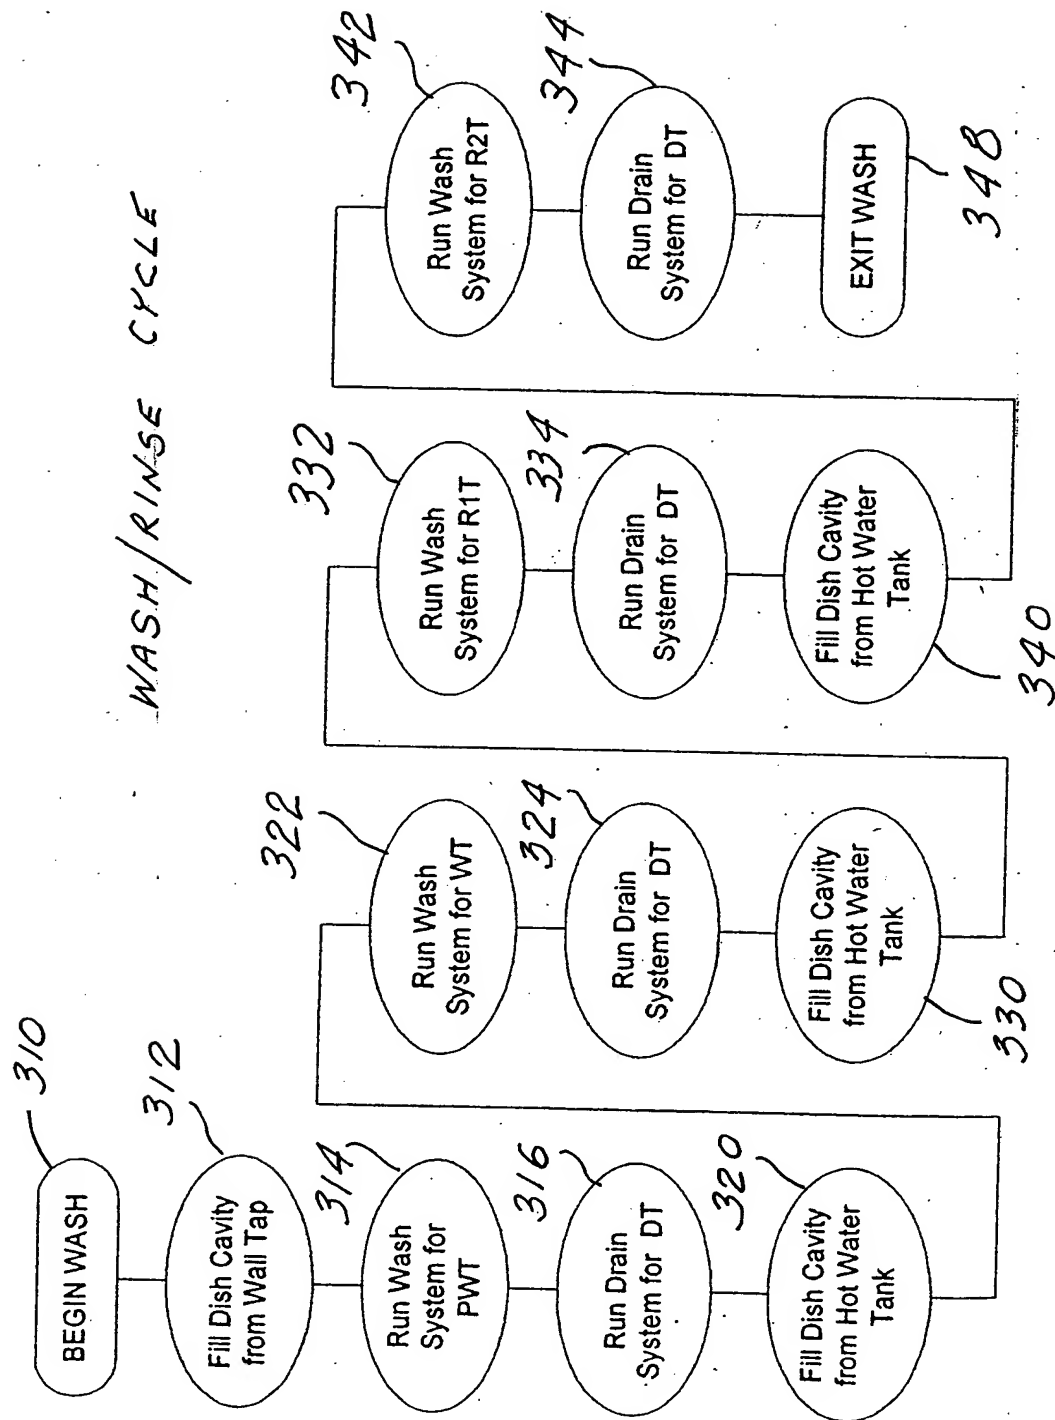

1007A

COMMERCIAL
GRADE
SANITIZATION

133

180

170

160

051

140

130

071

100

90

Figure 10.1: A simple graph

TEMP.

Fig. 7

131

2.28

134

cycles

104

NORMAL

20

STANDARD

143

15 JAN 1961

2

COMMERCIALLY

SANITIZE

1165

30 min.

104

110

112

DRY

132

2.

AIR

)

13
*

130

DRAIN

THANK

•
•

•

•

Downloaded from <http://www.jstor.org/stable/2346192> on Tue, 20 Jun 2016 12:02:02 UTC
All use subject to <http://about.jstor.org/terms>

130A

021

1308